


MINIMUM DRIVEWAY WIDTH - 24 FEET  
MAXIMUM DRIVEWAY WIDTH - 36 FEET


#4 EPOXY COATED REINFORCING RODS PLACED 12" ON CENTER IN BOTH DIRECTIONS THROUGH OUT THE SLAB. THEY SHALL BE PLACED TO BE 3" CLEAR OF SLAB EDGES.

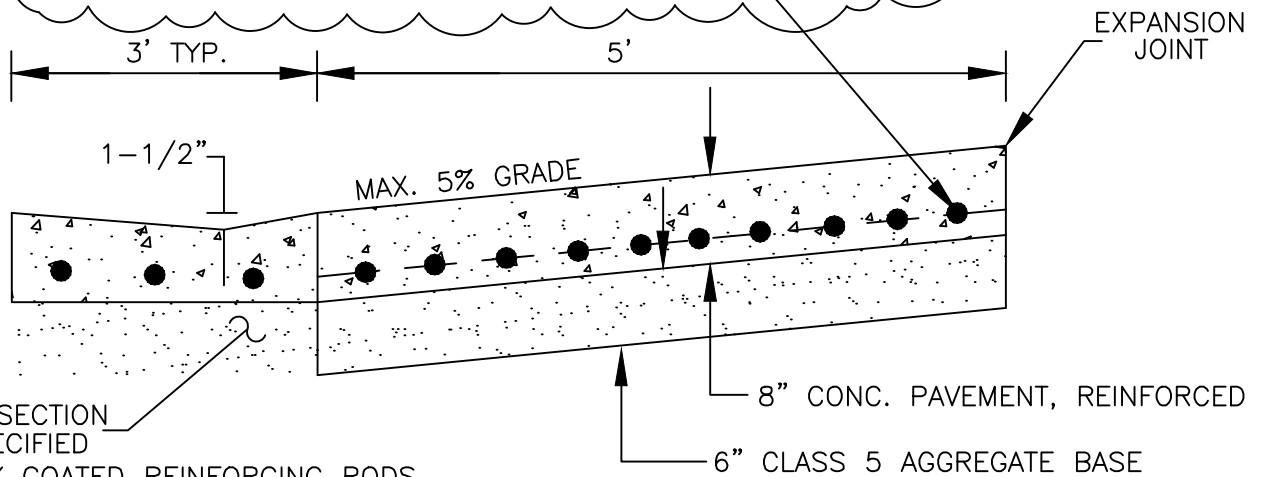

STREET SECTION  
AS SPECIFIED

3 #4 EPOXY COATED REINFORCING RODS  
CONTINUOUS IN CROSS GUTTER FROM  
EXPANSION JOINT TO EXPANSION JOINT.

SECTION A-A

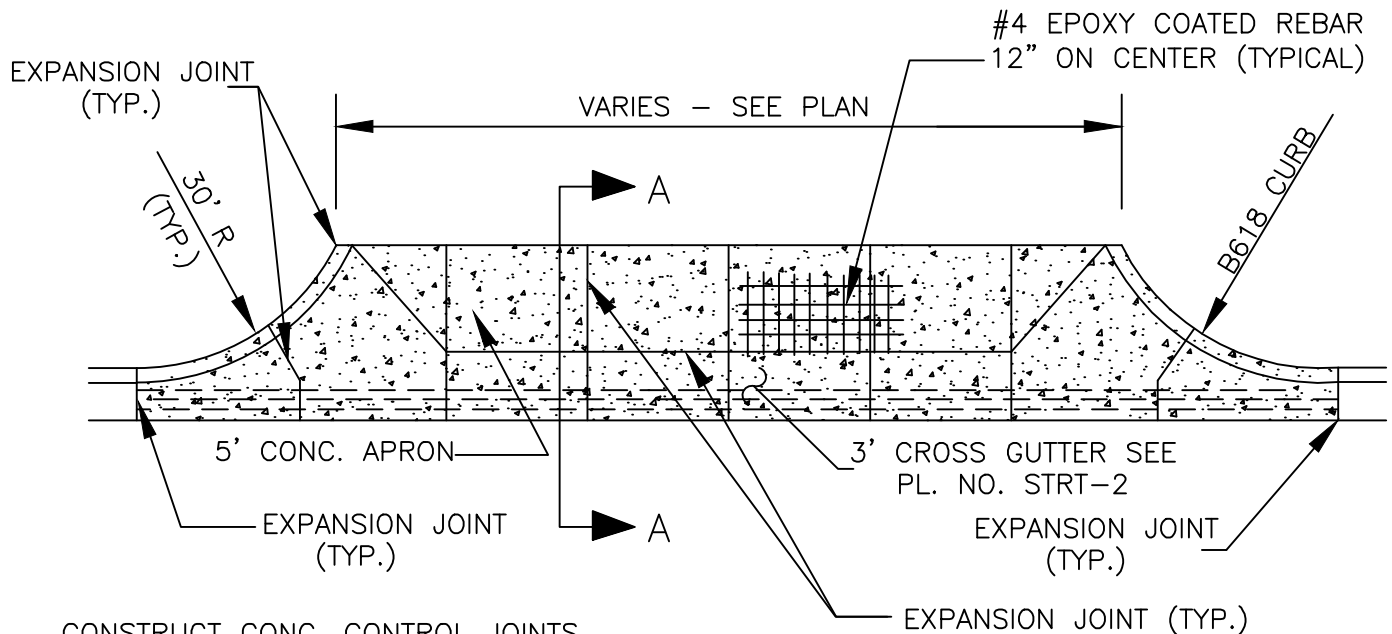

CONSTRUCT CONC. CONTROL JOINTS  
SUCH THAT NO PANEL IS GREATER  
THAN 100 SQ. FT.

PLAN

SEE PLATES NO. STRT-3 TO 8  
FOR PED. CURB RAMPS IF  
SIDEWALK OR TRAIL IS  
EXISTING OR TO BE  
INSTALLED.

NOTE: DRIVEWAY SHALL BE CONSTRUCTED AS  
A MONOLITHIC POUR. CURB SHALL NOT BE  
RUN THROUGH THE DRIVE BUT STOPPED AT  
THE BEGIN AND END RADII.



STANDARD DETAILS  
INDUSTRIAL / COMMERCIAL DRIVEWAY  
CITY OF PLYMOUTH

PUBLISHED  
1-24

CITY PL. NO.  
STRT-12  
REVISED 3-23